



# HPSPX-LP Differential pressure PI controller

The HPSPX-LP series are high resolution differential pressure controllers (-125–125 Pa). The integrated PI control with anti-windup function offers the possibility to directly control EC motors / fans. They are equipped with a fully digital state-of-the-art pressure transducer designed for a wide range of applications. Zero point calibration and Modbus registers reset can be executed via a tact switch. They also feature integrated K-factor and an analogue / modulating output (0–10 VDC / 0–20 mA / 0–100 % PWM). All parameters are accessible via Modbus RTU (3SModbus software or Sensistant).



#### **Key features**

- Built-in digital high resolution differential pressure sensor
- Air velocity detection (by using an external PSET-PTX-200 Pitot tube connection set)
- · Variety of operating ranges
- Selectable response time: 0,1-10 s
- Implemented K-factor
- Differential pressure, air volume flow<sup>(1)</sup> or air velocity<sup>(2)</sup> readout via Modbus RTU
- Modbus registers reset function (to factory pre-set values)
- Selectable internal voltage source for PWM output: 3,3 / 12 VDC
- Four LED indicators for the status of the transmitter and the controlled values
- Modbus RTU communication
- · Sensor calibration procedure
- Selectable minimum and maximum span
- Selectable analogue / modulating output
- Aluminium pressure connection nozzles

Article code:							
Codes	Power supply	Maximum power consumption	Nominal power consumption	Imax	Operating range		
HPSPF-LP	18-34 VDC	1,3W	1,26 W	71 mA	-125—125 Pa		
HPSPG-LP	18—34 VDC 15—24 VAC ±10 %	1,3 W	1,26 W	70 mA			
		1 W	1 W				

	Technical specifications			
	0-10 VDC	$R_{L} \ge 50 \text{ k}\Omega$		
Selectable analogue / modulating output	0—20 mA	$R_L \le 500 \Omega$		
modulating output	0-100 % PWM	PWM Frequency: 1 kHz, $R_L \ge 50 \text{ k}\Omega$		
	Differential pressure			
Operating modes	Air volume			
	Air velocity			
Accuracy	±2 % of the operating rang			
Protection standard	IP65 (according to EN 60529)			
Enclosure	ASA, grey (RAL9002)			
A	Temperature	-5—65 °C		
Ambient conditions	Rel. humidity	< 95 % rH (non-condensing)		

#### Area of use

- Differential pressure, air volume flow<sup>(1)</sup> or air velocity <sup>(2)</sup> measurement in HVAC applications
- Overpressurizing applications: clean rooms to avoid particle contamination or staircases for fire safety
- Underpressurizing applications: restaurant kitchens and biohazard laboratories
- Volume flow application: ensuring the minimum legal ventilation rate (m³/h) for buildings

Wiring and connections								
Article type	HPSPF-LP	HPSPG-LP						
Vin	18-34 VDC	18-34 VDC	13-26 VAC					
GND	Ground	Common ground*	AC ~*					
Α	Modbus RTU (RS485), signal A							
/B	Modbus RTU (RS485), signal /B							
AO1	Analogue / modulating output (0 $-10~VDC$ / 0 $-20~mA$ / PWM)							
GND	Ground AO1	Common ground*						
Connections	Cable cross section		1,5 mm²					

\*Attention! The -F version of the product is not suited for 3-wire connection. It has separate grounds for power supply and analogue output. Connecting both grounds together might result in incorrect measurements. Minimum 4 wires are required to connect -F type sensors.

The -G version is intended for 3-wire connection and features a 'common ground'. This means that the ground of the analogue output is internally connected with the ground of the power supply. For this reason, -G and -F types cannot be used together on the same network. Never connect the common ground of -G type articles to other devices powered by a DC voltage. Doing so might cause permanent damage to the connected devices.

S.1.6.O.67 www.sentera.eu

<sup>(1)</sup> Only when K-factor of fan / drive is known. If K-factor is unknown, volume flow can be calculated via multiplying the duct cross-sectional area (A) by the air velocity (V) using the formula: Q = A \* V (1) Only when duct cross-section is known by using an external PSET-PTX-200 Pitot tube connection set







## HPSPX-LP

**Operational diagrams** 

Differential pressure PI controller

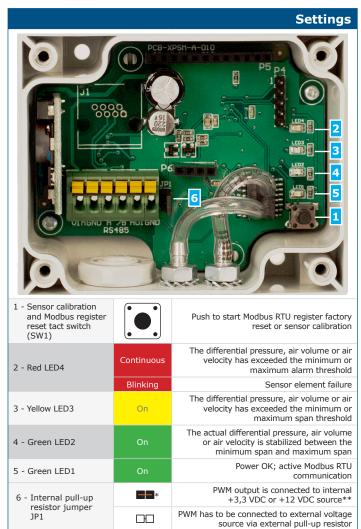



<sup>\*</sup> indicates closed position of the jumper.

\*\* The voltage source depends on the value in holding register 54.

### Input (DP, VFR, AV) Max alarm Max span Setpoint Min span Min alarm t (s) 100 Differential pressure/volume flow/ air velocity full scale (%) 90 80 70 60 50 40 30 Setpoint 20 Kp = 20 Kp = 10 - Kp = 5 0 10 20 30 40 50 60 70 80 90 Time [s]


#### **Standards**

EN 61326-1:2013 Electrical equipment for measurement, control and laboratory use - EMC requirements - Part 1: General requirements

EN 61326-2-3:2013 Electrical equipment for measurements

EN 61326-2-3:2013 Electrical equipment for measurement, control and laboratory use - EMC requirements - Part 2-3: Particular requirements. Test configuration, operational conditions and performance criteria for transducers with integrated or remote signal conditioning

- WEEE Directive 2012/19/EC
- RoHs Directive 2011/65/EC

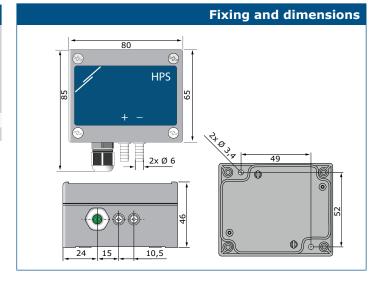







## HPSPX-LP

Differential pressure PI controller

Application 1: Measuring differential pressure [Pa] or air flow volume [m³/h] using PSET-PVC

**Application 2:** Measuring supplied air volume [m³/h] or airflow velocity [m/s] using PSET-PT

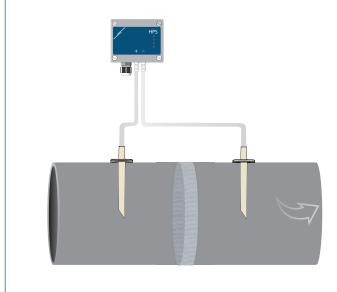

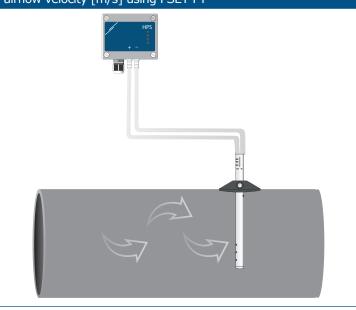

#### **Modbus registers**



The Sensistant Modbus configurator allows you to easily monitor and/or configure Modbus parameters.

The parameters of the unit can be monitored / configured through the 3SModbus software platform. You can download it from the following link: https://www.sentera.eu/en/3SMCenter

For more information about the Modbus registers, please refer to the product Modbus Register Map.

#### **Packaging** Length Article code Packaging [mm] [mm] weight Unit (1 pc.) 95 70 0,12 kg 0,13 kg HPSPF-LP HPSPG-LP Carton (10 pcs.) 495 185 87 1,20 kg 1,30 kg Box (60 pcs.) 590 380 280 7,2 kg 7,8 kg