


RCVCH-R

Intelligent TVOC room sensor



The RCVCH-R are intelligent room sensors for measuring temperature, relative humidity and TVOC ranges. The used algorithm controls a single analogue / modulating output based on the measured temperature, humidity and TVOC values, which can be used to directly control an EC fan, an AC fan speed controller or an actuator powered damper. They feature 24 VDC power supply and an ambient light sensor. All parameters are accessible via Modbus RTU.

Key features

- Spring contact terminal block or RJ45 connection
- Selectable temperature, relative humidity and TVOC ranges
- Silicon based sensor elements for TVOC measurements
- Fan speed control based on temperature, humidity and TVOC
- Bootloader for updating the firmware via Modbus RTU communication
- Day / Night detection via ambient light sensor
- Ambient light sensor with adjustable 'active' and 'standby' level
- Modbus RTU communication
- Replaceable TVOC sensor module
- 3 LEDs with adjustable light intensity for status indication
- Long-term stability and accuracy

Area of use

- Demand controlled ventilation based on measured temperature, relative humidity and TVOC
- Suitable for residential and commercial buildings
- For indoor use only

Technical specifications

Analogue / modulating output	0—10 VDC mode: $R_L \geq 50 \text{ k}\Omega$	
	0—20 mA mode: $R_L \leq 500 \Omega$	
	PWM (open-collector type) mode: 1 kHz, $R_L \geq 50 \text{ k}\Omega$, PWM voltage level: 3,3 VDC or 12 VDC	
Warm-up time	15 minutes	
Typical field of use	Temperature range	0—50 °C
	Relative humidity range	0—95 % rH (non-condensing)
	TVOC range	0—60.000 ppb
Accuracy	$\pm 0,4 \text{ }^\circ\text{C}$ (0—50 °C)	
	$\pm 3\%$ rH (range 0—100 %) / $\pm 15\%$ TVOC (range 0—60.000 ppb)	
Protection standard	IP30 (according to EN 60529)	

Article codes

Article code	Supply voltage	Imax	Connection type
RCVCH-R	24 VDC	45 mA	RJ45 or terminal block

Modbus registers



The Sensistant Modbus configurator allows you to easily monitor and/or configure Modbus parameters. The parameters of the unit can be monitored / configured through the 3SMODBUS software platform. You can download it from the following link:
<https://www.sentera.eu/en/3SMCenter>
 For more information about the Modbus registers, please refer to the product Modbus Register Map.



Wiring diagram

RJ45 sockets (Power over Modbus)

Pin	Signal	Description
Pin 1	24 VDC	Supply voltage
Pin 2		
Pin 3	A	Modbus RTU communication, signal A
Pin 4		
Pin 5	/B	Modbus RTU communication, signal /B
Pin 6		
Pin 7	GND	Ground, supply voltage
Pin 8		



Terminal Block 1

VIN	Supply voltage 24 VDC
GND	Supply voltage, ground
A	Modbus RTU communication, signal A
/B	Modbus RTU communication, signal /B


Terminal Block 2

AO1	Analogue / modulating output - temperature, humidity or TVOC measurement (0—10 VDC / 0—20 mA / PWM)
GND	Ground AO1


Attention! The unit needs to be supplied via the RJ45 connector or via the connection terminals. Do not connect the device via the RJ45 connector and the terminal block simultaneously!

RCVCH-R

Intelligent TVOC room sensor




Settings and indications

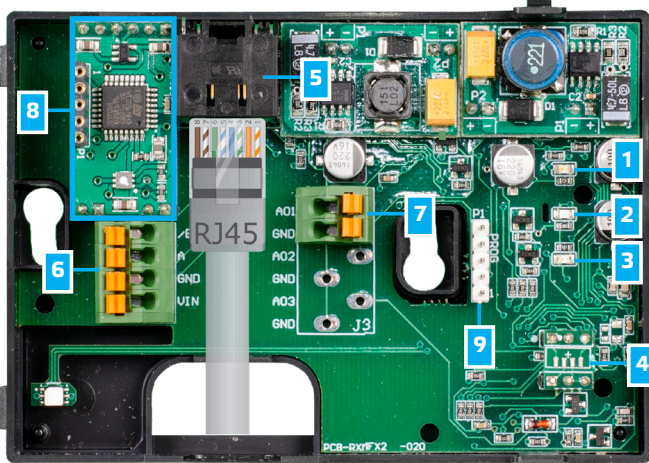


1 - Red LED	On	Measured temperature, relative humidity or TVOC values are out of range
	Blinking	Communication with one of the sensors fails
2 - Yellow LED	On	Measured temperature, relative humidity or TVOC values are in the alert range
	Blinking	Modbus communication has stopped and HR8 is activated (Modbus timeout > 0 seconds)
3 - Green LED	On	Measured temperature, relative humidity or TVOC values are within range
	Blinking	TVOC sensor is warming up
4 - Ambient light sensor		Low light intensity / Active / Standby
5 - RJ45 socket		Modbus communication with connected Master devices and PoM voltage supply (24 VDC)
		Blinking LEDs indicate that packages are transmitted via Modbus RTU communication
6 - Terminal block input connection		24 VDC supply voltage and Modbus RTU signal
7 - Output connection		AO1 - Temperature, relative humidity or TVOC
8 - TVOC sensor element		Replaceable in case of faulty operation
9 - PROG header, P1		Put a jumper onto pins 1 and 2 and wait for at least 5 seconds to reset the Modbus communication parameters
		Put a jumper onto pins 3 and 4 and restart the power supply to enter bootloader mode

Note: By default, the LED indicators visualise the measured TVOC level. When the sensor is in bootloader mode, the green and yellow LEDs flash alternately. During the firmware download, the red LED is flashing additionally.

Fixing and dimensions

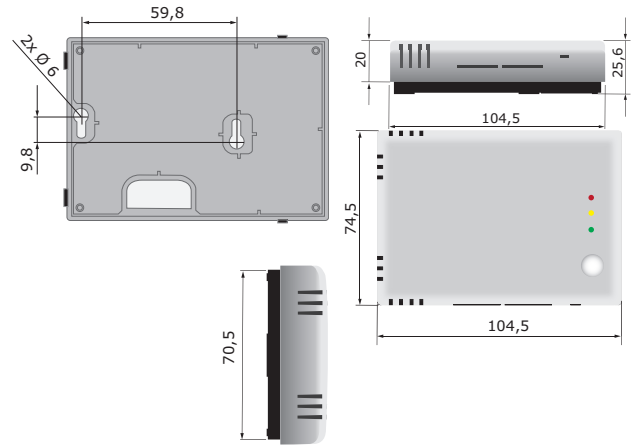


Operational diagram(s)

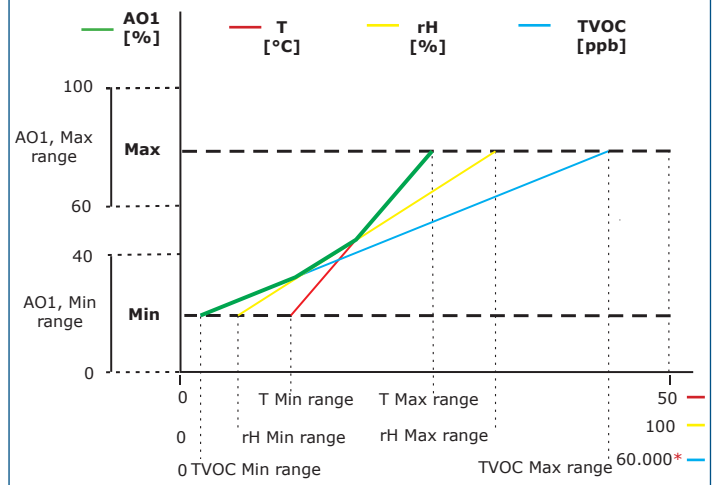


*TVOC measurements will return 0 ppb during warm-up time.

Note: The output changes automatically depending on the higher of the T, rH or TVOC values, i.e. the highest of the three output values controls the output. One or multiple sensors can be deactivated. E.g. it is possible to control the output based on the measured TVOC value only.

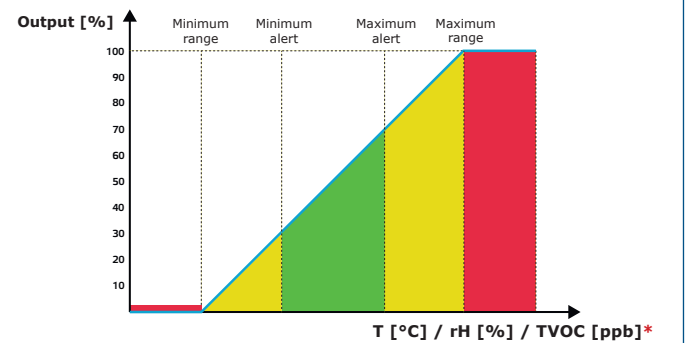


*LED indications - T, rH or TVOC (default)



RCVCH-R

Intelligent TVOC room sensor


Standards

- Low Voltage Directive 2014/35/EU 
 - EN 60529:1991 Degrees of protection provided by enclosures (IP Code) Amendment AC:1993 to EN 60529
 - EN 60730-1:2011 Automatic electrical controls for household and similar use - Part 1: General requirements
- EMC directive 2014/30/EU:
 - EN 60730-1:2011 Automatic electrical controls for household and similar use - Part 1: General requirements
 - EN 61000-6-1:2007 Electromagnetic compatibility (EMC) - Part 6-1: Generic standards - Immunity for residential, commercial and light-industrial environments
 - EN 61000-6-3:2007 Electromagnetic compatibility (EMC) - Part 6-3: Generic standards - Emission standard for residential, commercial and light-industrial environments. Amendments A1:2011 and AC:2012 to EN 61000-6-3
 - EN 61326-1:2013 Electrical equipment for measurement, control and laboratory use - EMC requirements - Part 1: General requirements
 - EN 61326-2-3:2013 Electrical equipment for measurement, control and laboratory use - EMC requirements - Part 2-3: Particular requirements. Test configuration, operational conditions and performance criteria for transducers with integrated or remote signal conditioning
- WEEE 2012/19/EU
- RoHs Directive 2011/65/EU

Global trade item numbers (GTIN)

Packaging	RCVCH-R
Unit	05401003018149
Carton	05401003302699
Box	05401003503874

Packaging

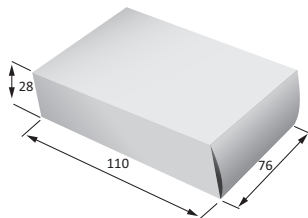

Article	Packaging	Length [mm]	Width [mm]	Height [mm]	Net weight	Gross weight
RCVCH-R	Unit (1 pc.)	110	76	28	0,089 kg	0,111 kg
	Carton (24 pcs.)	492	182	84	2,14 kg	2,804 kg
	Box (144 pcs.)	510	410	270	12,81 kg	18,066 kg