



RSMFM-3

Settings and indications

Multifunctional CO₂ room transmitter, PoM

The RSMFM-3 are multifunctional room transmitters which measure ${\rm CO}_2$ concentration levels, temperature, relative humidity and ambient light. They are Power over Modbus supplied and all parameters are accessible via Modbus RTU.

Key features

- Selectable CO₂, temperature and relative humidity ranges
- Outputs available via Modbus RTU input registers
- A bootloader for firmware updates using Modbus RTU communication
- Ambient light sensor with adjustable 'active' and 'standby' level
- 3 LEDs with adjustable light intensity for status indication
- Long-term stability and accuracy

Area of use

- \bullet Monitoring indoor temperature, relative humidity and CO_2 levels in HVAC applications
- Suitable for residential and commercial buildings
- For indoor use only

		Article codes		
Article code	Supply voltage	Imax	Connection type	
RSMFM-3	24 VDC, PoM	30 mA	RJ45 socket	

	Те	chnical specifications		
Supply voltage	24 VDC, Power over Modbus			
Typical range of use	Temperature	0-50 °C		
	Relative humidity	0-95 % rH (non-condensing)		
	CO ₂ range	400-2.000 ppm		
Accuracy		±0,5 °C (5-50 °C)		
	±6 % rH (20-80 % rH)			
	400-2.000 ppm CO ₂	\pm (50 ppm + 3 % of the reading)		
	2.001-5.000 ppm CO ₂	\pm (40 ppm + 5 % of the reading)		
Protection standard		IP30 (according to EN 60529)		

How to configure





- Easily change the parameter settings of the connected devices remotely
- Define users and give them access to monitor the installation via a standard web browser $\,$
- Log data create diagrams and export logged data
- Receive alerts or warnings when measured values exceed alert ranges or when errors occur
- Create different regimes for your ventilation system e.g. day-night regime

The 3SModbus software platform allows for monitoring and configuring the unit's parameters.

You can download it from the following link:



Please refer to the Modbus Register Map of the product for more details regarding the Modbus registers.




		_
1 - Red LED	On	Measured temperature or relative humidity values are out of range or CO_2 is higher than or equal to Alert 2 level
	Blinking	Communication with one of the sensors fails
2 - Yellow LED	On	Measured temperature or relative humidity values are in the alert range or CO_2 is higher than or equal to Alert 1 level
3 - Green LED	On	Measured temperature or relative humidity values are within range or $\mathrm{CO_2}$ level is lower than Alert 1 level
4 - Ambient light sensor		Low light intensity / Active / Standby
5 - CO ₂ sensor element	To measure CO ₂ concentration, self-calibrating	
6 - PROG header, P1	1 2 3 4 5	Put a jumper on pins 1 and 2 and wait for at least 5 seconds to reset the Modbus communication parameters
	1 2 3 4 5	Put a jumper on pins 3 and 4 and restart the supply to enter bootloader mode

Note: By default, the LED indicators visualise the measured ${\rm CO_2}$ level. When the sensor is in bootloader mode, the green and yellow LEDs flash alternately. During the firmware download, the red LED is flashing additionally.




RSMFM-3


Multifunctional CO₂ room transmitter, PoM

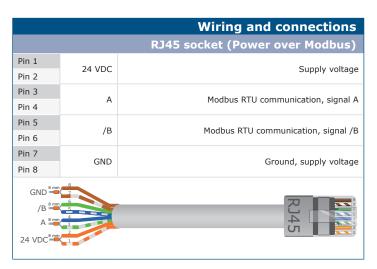


Standards

- Low Voltage Directive 2014/35/EU
 - -EN 60529:1991 Degrees of protection provided by enclosures (IP Code) Amendment AC:1993 to EN 60529 $\,$
 - EN 60730-1:2011 Automatic electrical controls for household and similar use -Part 1: General requirements
- EMC Directive 2014/30/EU EN 60730-1:2011 Automatic electrical controls for household and similar use -Part 1: General requirements
 - EN 6100-6-1:2007 Electromagnetic compatibility (EMC) Part 6-1: Generic standards Immunity for residential, commercial and light industrial environments
 - EN 61000-6-3:2007 Electromagnetic compatibility (EMC) Part 6-3: Generic standards Emission standard for residential, commercial and light-industrial environments Amendments A1:2011 and AC:2012 to EN 61000-6-3
- environments Amendments A1:2011 and AC:2012 to EN 61000-6-3 EN 61326-1:2013 Electrical equipment for measurement, control and laboratory use EMC requirements Part 1: General requirements EN 61326-2-3:2013 Electrical equipment for measurement, control and laboratory use EMC requirements Part 2-3: Particular requirements Test configuration, operational conditions and performance criteria for transmitters with integrated or remote signal conditioning.
- WEEE 2012/19/EU
- RoHs Directive 2011/65/EU
- ${\rm EN~IEC~63000:}2018$ Technical documentation for the assessment of electrical and electronic products with respect to the restriction of hazardous substances

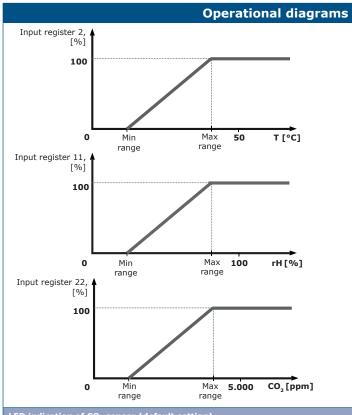

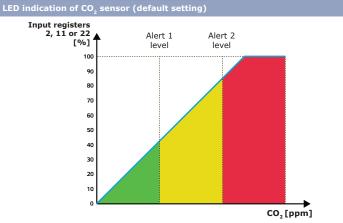

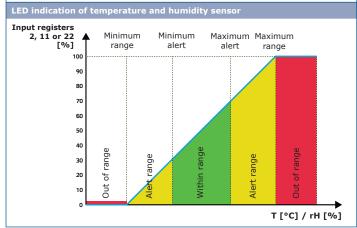



 $\begin{array}{c} \text{RSMFM-3} \\ \text{Multifunctional CO}_2 \text{ room transmitter, PoM} \end{array}$

	Global trade item numbers (GTIN)
Packaging	RSMFM-3
Unit	05401003018873
Carton	05401003302965
Box	05401003504390

